


II-C1500-1

INSTALLATION INSTRUCTIONS

ELECTRIFIED CYLINDRICAL LOCKS WITH C1510C OR C1520C MODIFICATION.

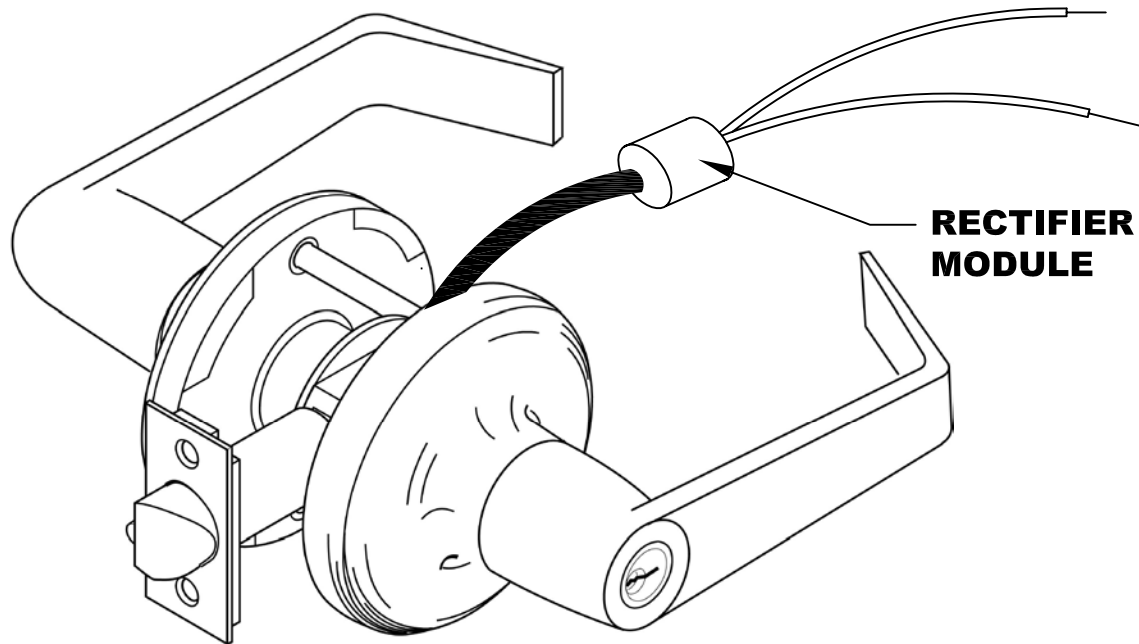

TERMINATE THE TWO BLUE WIRES FROM LOCK TO THE ELECTRIC POWER TRANSFER DEVICE USING 22 AWG WIRE. USE PROPER CRIMP SPLICES OR WIRE NUTS FOR TERMINATING CONNECTIONS. (NO POLARITY OF WIRES IS REQUIRED)

NOTE: WARRANTY IS VOID IF RECTIFIER MODULE IS REMOVED.

ELECTRICAL SPECIFICATIONS

24 VOLTS AC/DC +/- 10%
OPERATING CURRENT .150 AMP

12 VOLTS AC/DC +/- 10%
OPERATING CURRENT .250 AMP

