


II - E1500-22

EXIT DEVICE INSTALLATION INSTRUCTIONS REQUEST FOR EXIT SWITCH (RX)

FOR USE WITH REGENT 5700 SERIES EXIT DEVICES
SWITCH MONITORS EGRESS BY PUSHBAR ACTIVATION
OF EXIT DEVICE.

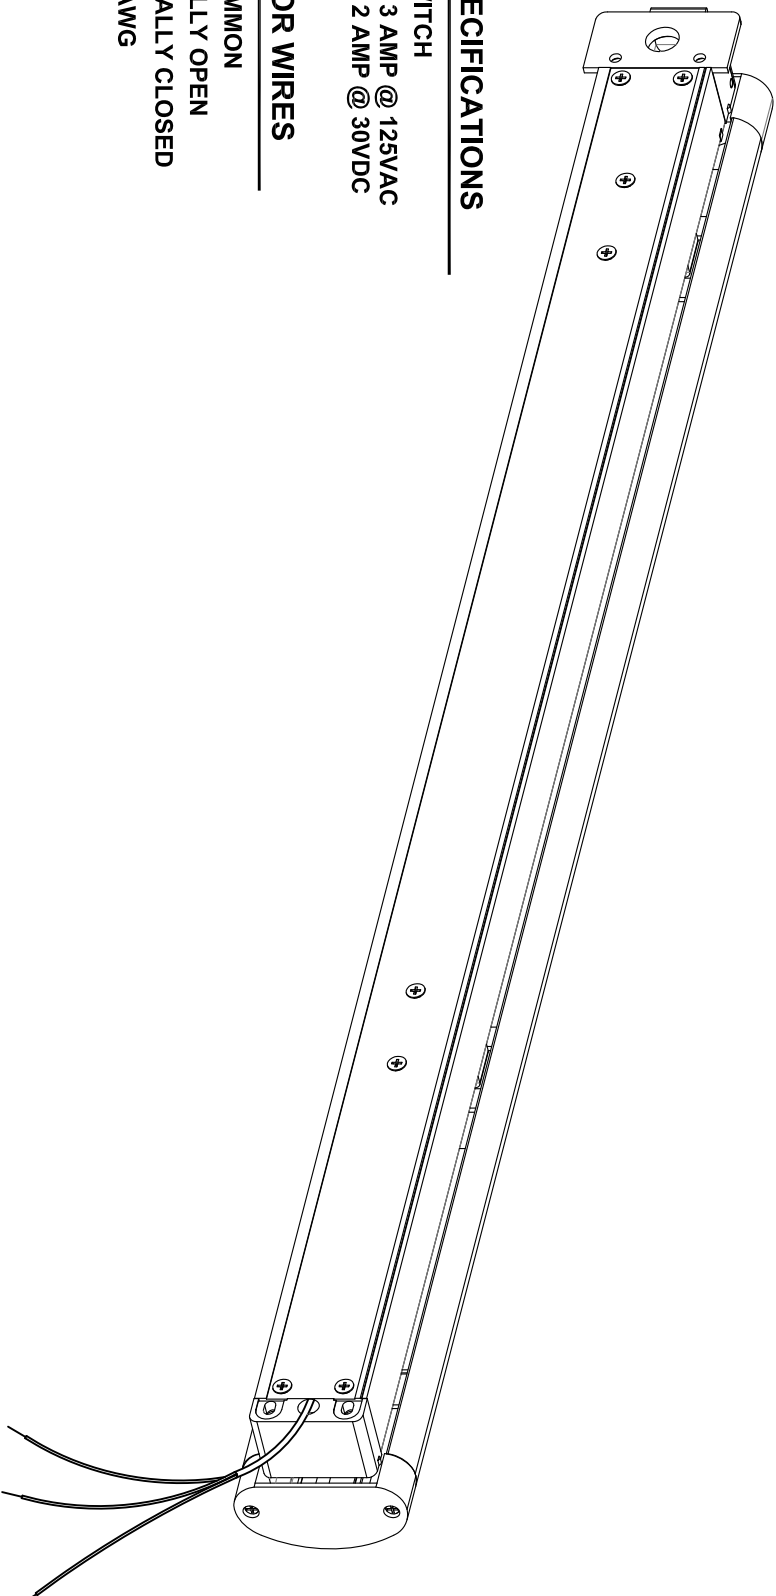

ELECTRICAL SPECIFICATIONS

- SPDT MONITOR SWITCH
- CONTACT RATING: 3 AMP @ 125VAC
2 AMP @ 30VDC

COLOR CODE FOR WIRES

- YELLOW WIRE: COMMON
- RED WIRE: NORMALLY OPEN
- GRAY WIRE: NORMALLY CLOSED
- WIRE GAUGE: #22 AWG

NOTES: 1.) USE MANUFACTURER'S TEMPLATING FOR
DOOR PREPARATION. PROVIDE ADDITIONAL PREP
AS SHOWN ON EXIT DEVICE TEMPLATE E1500-15.



2720 CLARK AVE., ST. LOUIS, MO 63103 (800) 753-5558

REV. 07/11