




Safety Technology International, Inc.
2306 Airport Road • Waterford, Michigan 48327-1209
Phone: 248-673-9898 • Fax: 248-673-1246
Toll Free: 800-888-4784 • E-mail: info@sti-usa.com
Web: www.sti-usa.com

Safety Technology International (Europe) Ltd.
Unit 49G Pipers Road • Park Farm Industrial Estate • Redditch
Worcestershire • B98 0HU • England
Tel: 44 (0) 1527 520 999 • Fax: 44 (0) 1527 501 999
E-mail: info@sti-europe.com • Web: www.sti-europe.com

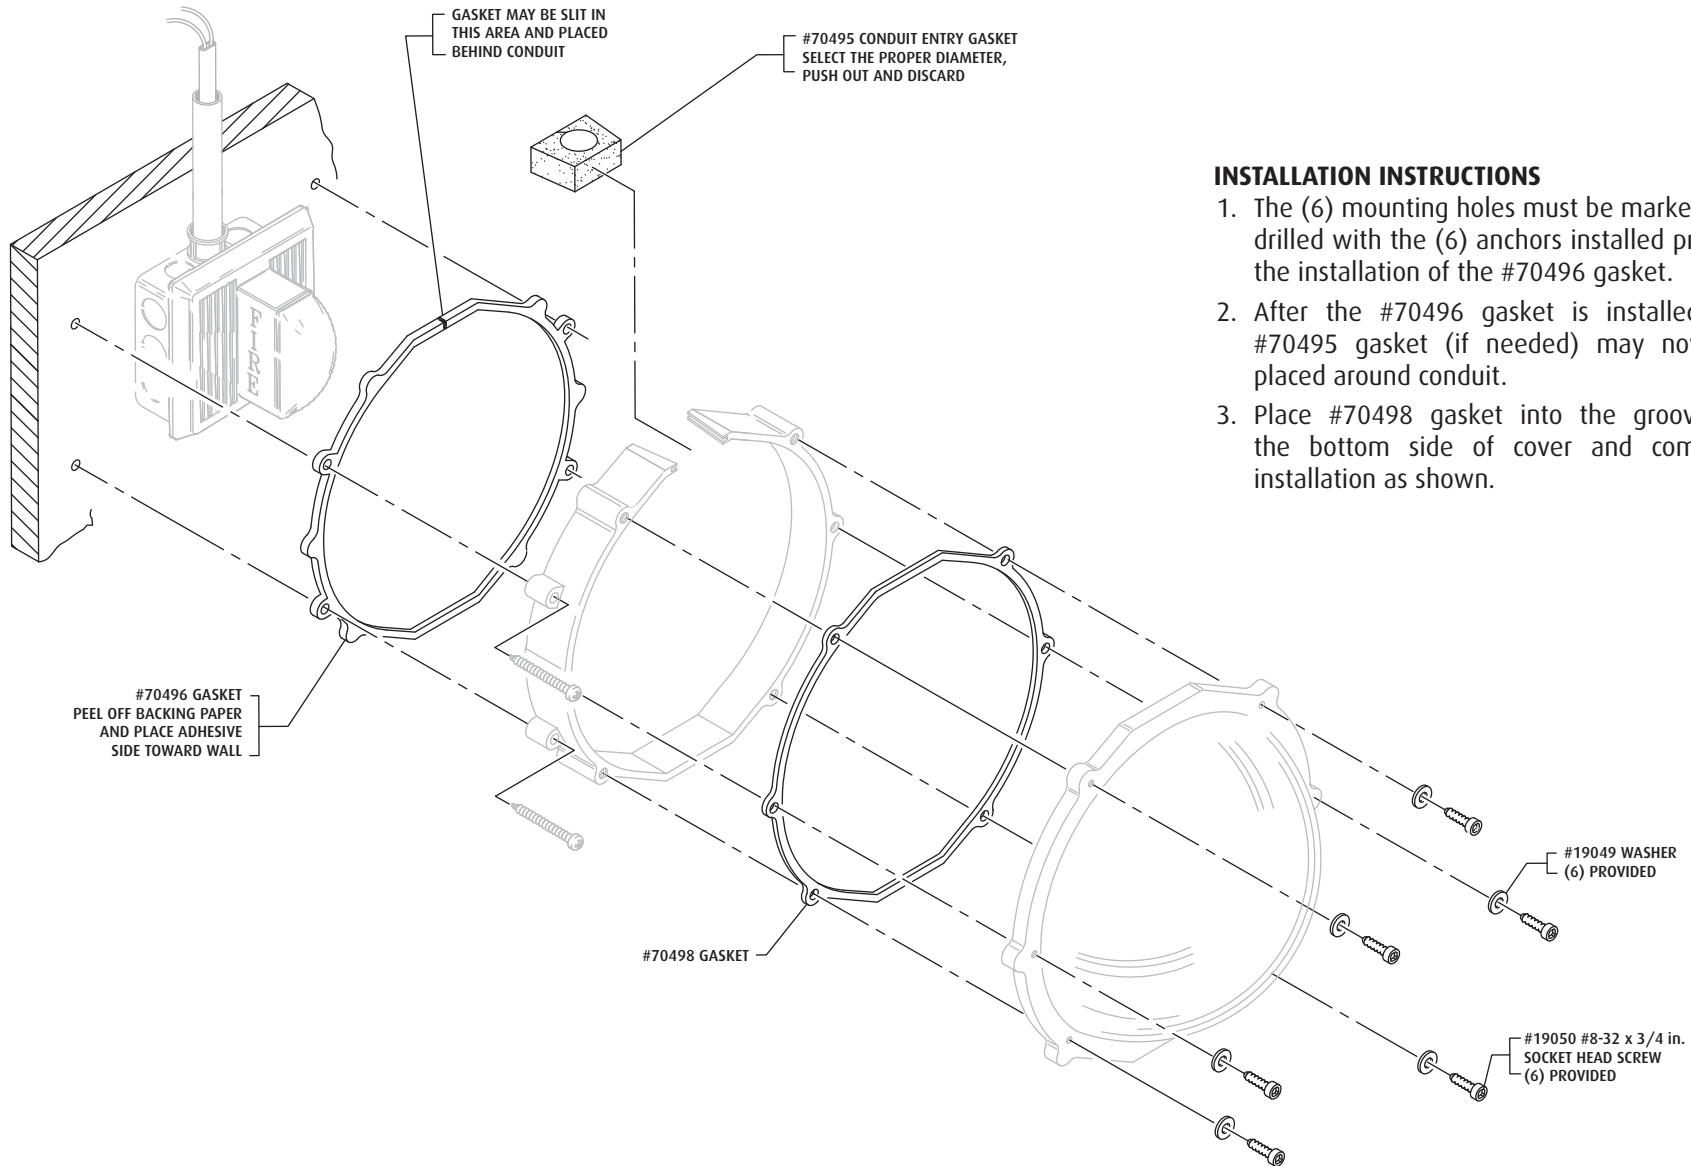

INSTALLATION INSTRUCTIONS

1. The (6) mounting holes must be marked and drilled with the (6) anchors installed prior to the installation of the #70496 gasket.
2. After the #70496 gasket is installed the #70495 gasket (if needed) may now be placed around conduit.
3. Place #70498 gasket into the groove on the bottom side of cover and complete installation as shown.

INSTALLATION OF SUB-123 ENVIRO-KIT

All specifications and information shown were current as of publication and are subject to change without notice.

SUB-123IS JAN 2000

