


INSTALLATION INSTRUCTIONS

MODELS TS-2T, TS-3T, TS-4T, TS-5T



U.L. FILE SA32686

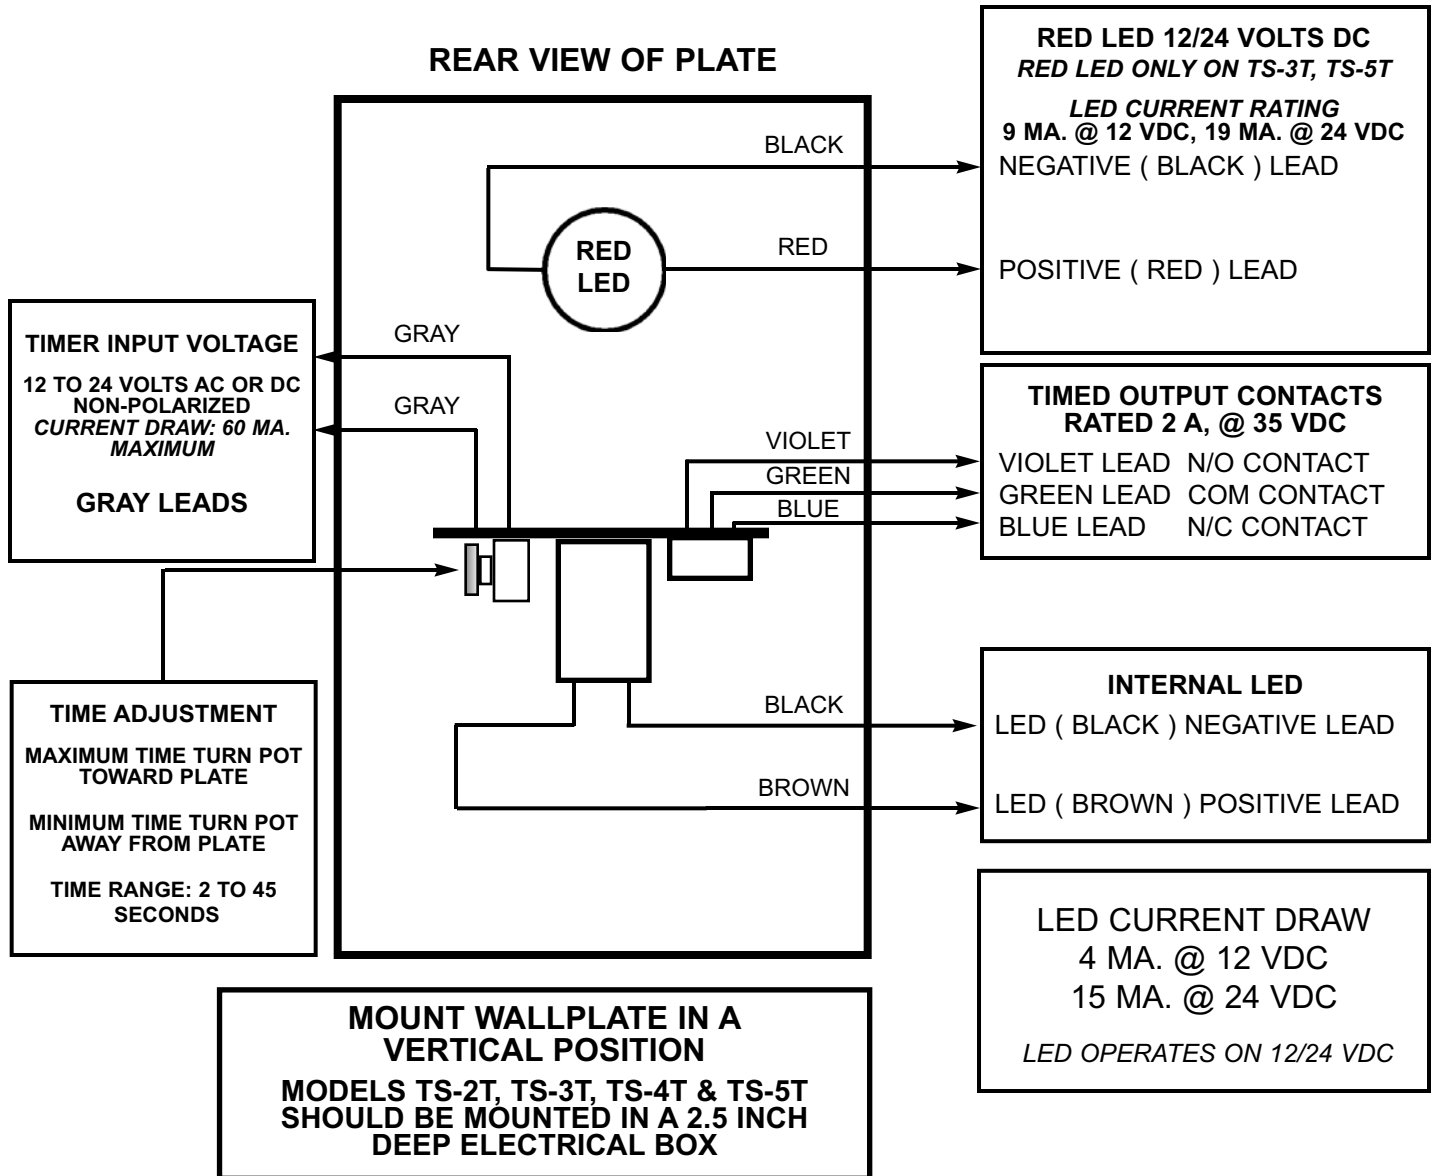


NOTE: TIMER WILL ACTIVATE WHEN **PUSH TO EXIT** SWITCH IS DEPRESSED.
SUBSEQUENT DEPRESSIONS OF THE SWITCH WILL RE-START THE TIMER.



ALARM CONTROLS CORPORATION
19 BRANDYWINE DRIVE P.O. BOX 280
DEER PARK, NY 11729

PH: 1 800 645-5538 1 631 586-4220 FAX ; 1 631 586-6500
WWW.ALARMCONTROLS.COM EMAIL: INFO@ALARMCONTROLS.COM

TYPICAL WIRING DIAGRAMS FOR MODEL TS-2T

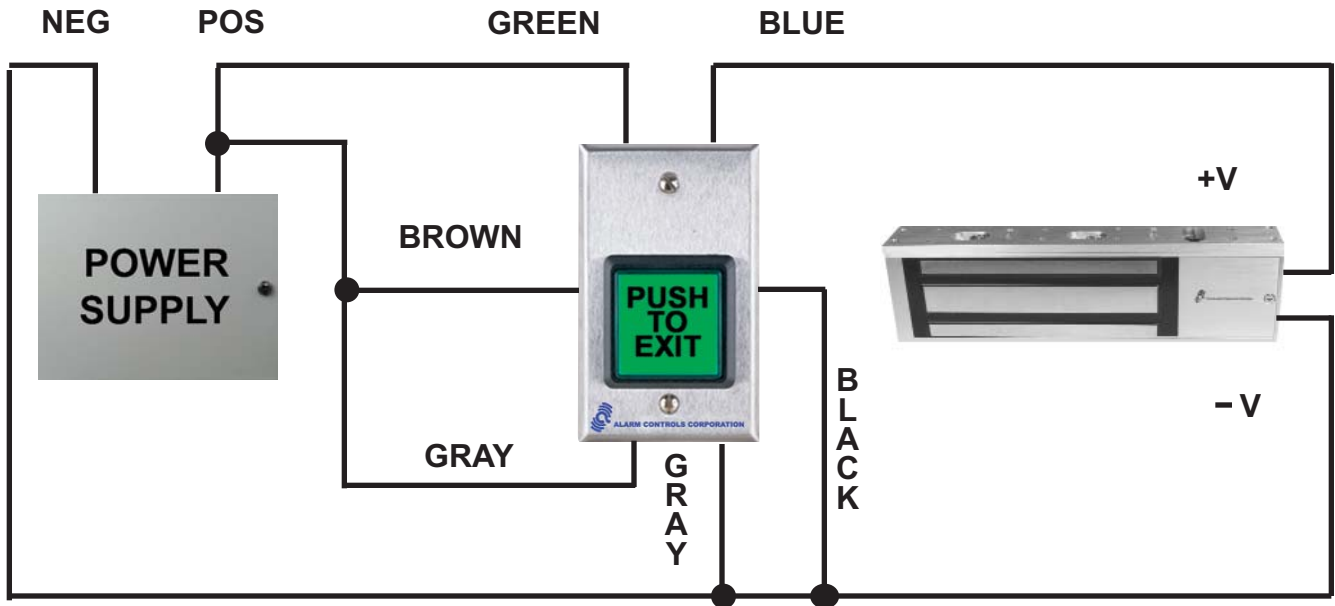

ELECTRIC DOOR STRIKE FAIL SECURE MODE

